

Carbon Monoxide (CO) Device Decision Tree

December 23, 2022


A guide for determining CO requirements based on sources of carbon monoxide and location

CR = Classroom

FBA = Fuel Burning Appliance


FBF = Fuel Burning Fireplace

FBFAF = Fuel Burning Forced Air
Furnace

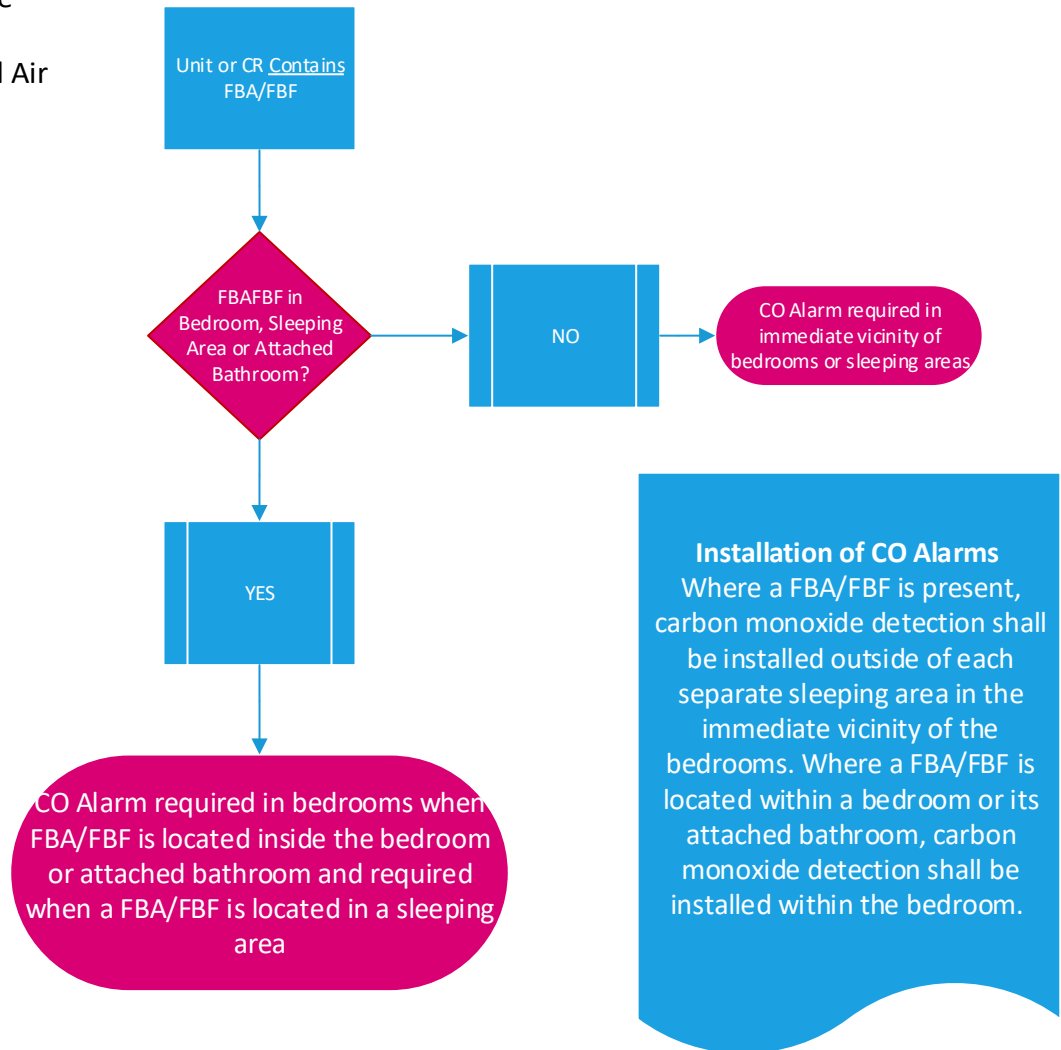

Unit or Classroom Served by an Outside Fuel Burning Appliance


CR = Classroom
FBA = Fuel Burning Appliance
FBF = Fuel Burning Fireplace
FBFAF = Fuel Burning Forced Air Furnace

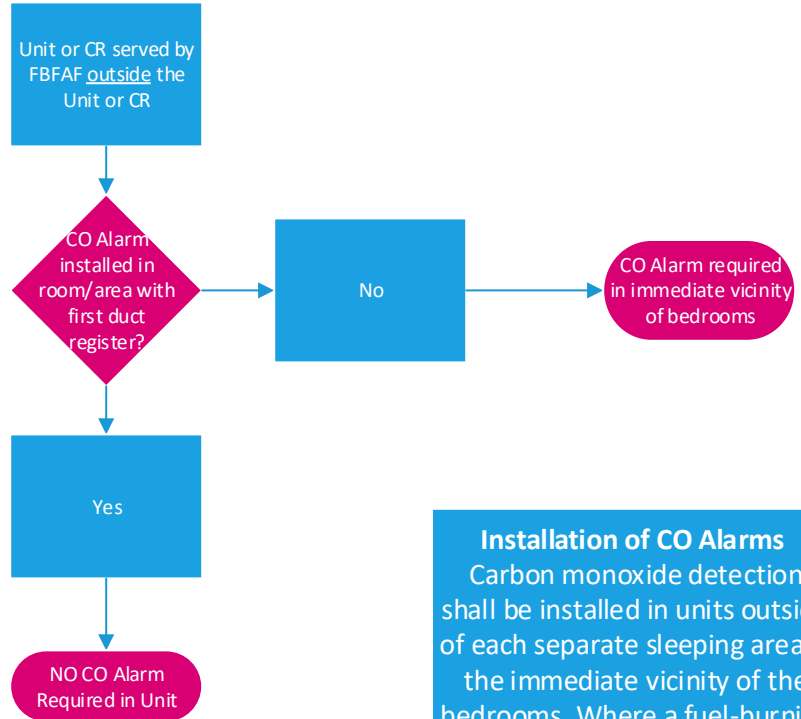

Installation of CO Alarms
Carbon monoxide detection shall be installed in units outside of each separate sleeping area in the immediate vicinity of the bedrooms. Where a fuel-burning appliance is located within a bedroom or its attached bathroom, carbon monoxide detection shall be installed within the bedroom.

Unit or Classroom Located in Buildings Containing a Fuel Burning Appliance or Fireplace

CR = Classroom
FBA = Fuel Burning Appliance
FBF = Fuel Burning Fireplace
FBFAF = Fuel Burning Forced Air Furnace

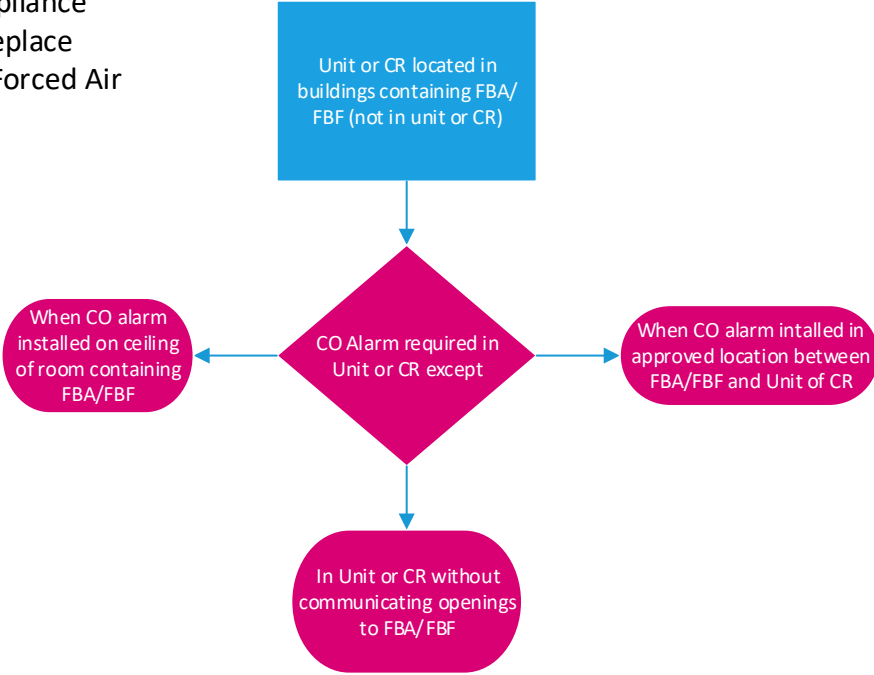

Unit or Classroom in Buildings With Attached Garages

CR = Classroom
FBA = Fuel Burning Appliance
FBF = Fuel Burning Fireplace
FBFAF = Fuel Burning Forced Air
Furnace

